

Firehouse Alarm and Emergency Signaling Device - Specifications

Firehouse




Dimensions

Height: 44.00" (1117.60 mm)
Width: 9.500" (241.30 mm)
Depth: 9.875" (250.83 mm)

Approximate
Weight: 20-26 lbs. (9.1-11.8 kg)

Multiply base dimensions by 25.4
for millimeters

Firehouse Base Diagram

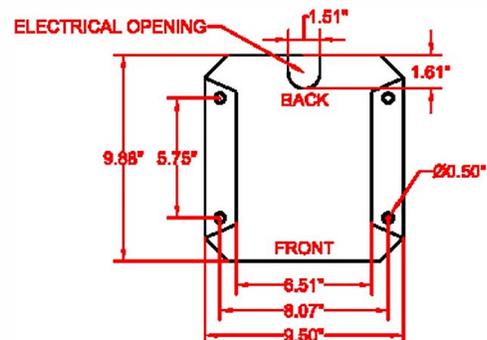

General Specifications for Firehouse Alarm & Emergency Signaling Device

All Power Pedestals Must Meet the Following:

Part I. General:

1.1 General Requirements:

- A. Shall be tested and certified to be in compliance with with UL2017 entitled "alarm and emergency signaling equipment."
- B. If a laboratory other than U.L. is used that laboratory must certify, in writing, that the alarm and emergency signaling equipment has been tested and meets all of the requirements of ANSI/UL 2017.
- C. Shall be certified to meet all sections of NFPA 303 DTD "2011 Marinas and Boatyards."
- D. Shall have the capability to house either a 10 lb. or 20 lb. A, B, and C fire extinguisher.
- E. Shall have downward, indirect illumination indicating the device is functioning properly.

Part II. Products:

2.1 Type SM (Self Monitoring) Emergency Signaling Device:

- A. www.boomarine.com
+86 13996027011

2.2 Type SM (Self Monitoring) Emergency Signaling Device - General Specification

- A. Main Housing:
 - a. The housing shall be constructed of 20 gauge, 316L low carbon stainless steel and shall be coated with UV-resistant polyurethane resin over a powder coating. It shall be UL listed as a type 3R weatherproof enclosure.
 - b. The housing shall have the capacity to house a 10 lb. or 20 lb. A, B, and C fire extinguisher.

Firehouse Alarm and Emergency Signaling Device - Specifications

- B. Access Door:
 - a. The access door shall be hinged with a stainless steel latch.
 - b. The door shall have a clear access window made of engineered resin.
 - c. Access to the fire extinguisher shall not require breakage of any part of the unit.

- C. Lighting Assembly / Housing:
 - a. The lighting top housing shall be constructed of 1/8" thick injection molded heavy resin material and shall be coated with a two part UV-resistant polyurethane. It shall be UL listed as a type 3R weatherproof enclosure.
 - b. STANDARD - Each pedestal shall be equipped with a non-metered light. The lighting assembly shall include one 14-watt compact fluorescent light, that is protected by a 0.5 amp, in-line fuse.
 - c. OPTION - Each pedestal shall be equipped with a non-metered LED light, that is protected by a 0.5 amp, in-line fuse. LED light shall be manufactured by Eaton - Marina Power & Energy.

- D. Wiring:
 - a. The alarm and emergency signaling device shall be completely pre-wired at the factory to the load side of the terminal strip.
 - b. All load copper wiring shall be of high stranding and tin plated to resist corrosion.
 - c. The maximum size of the line wiring shall be #6 AWG.

- E. Alarm System - Visual High-Intensity Strobe:
 - a. The audible alarm system shall have an output of 68 DBA, and a strobe light shall simultaneously activate to indicate the removal of the life ring and / or fire extinguisher.

- F. Grounding:
 - a. All exposed metallic parts must have an integral ground that is a part of the equipment grounding system.


- G. Fire Extinguisher (Optional):
 - a. Each cabinet shall be equipped with a 10 lb. or 20 lb. ABC fire extinguisher.

- H. Life Ring (Optional):
 - a. Each cabinet shall be equipped with a 24" life ring and provisions to sound an alarm system when the life ring is removed.


(END OF SECTION)

Firehouse Alarm and Emergency Signaling Device - Specifications

Product Features

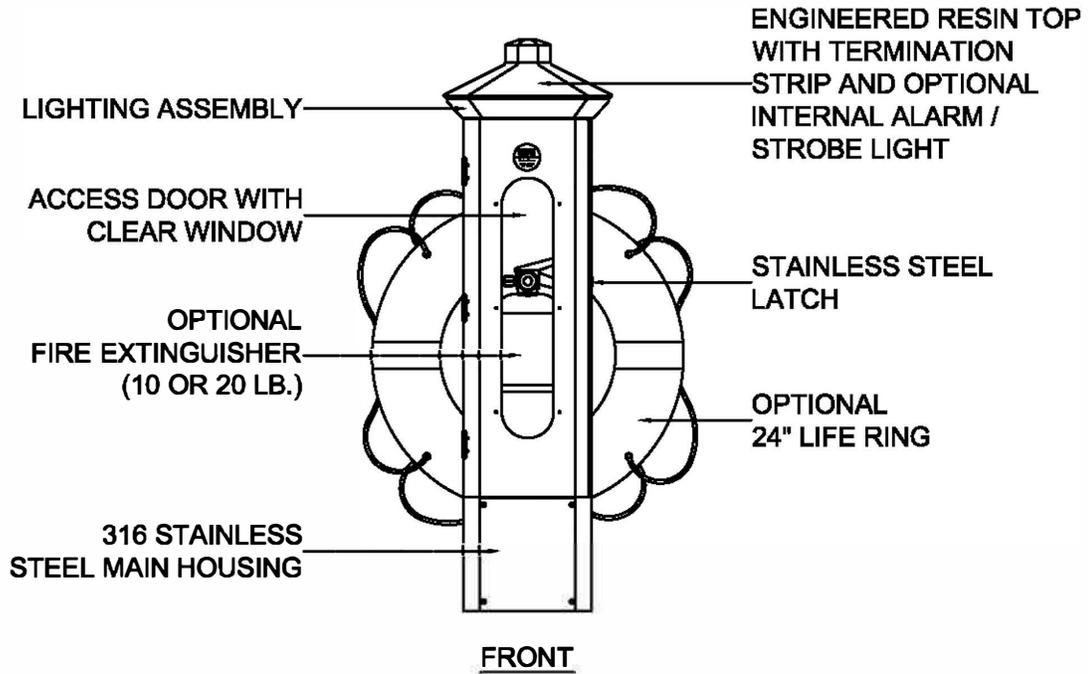


Dimensions

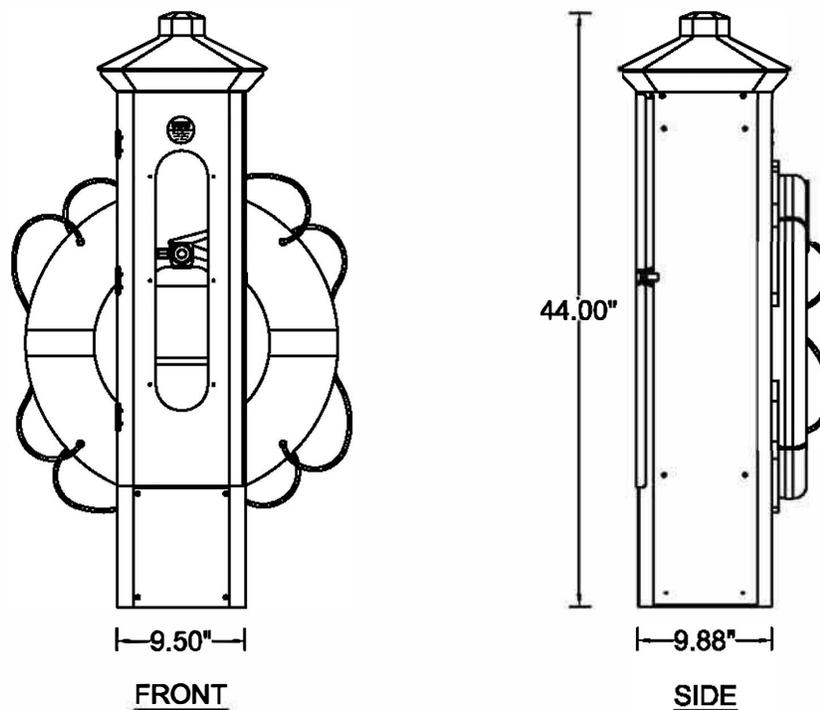

Firehouse Alarm and Emergency Signaling Device - Specifications

Base Dimensions

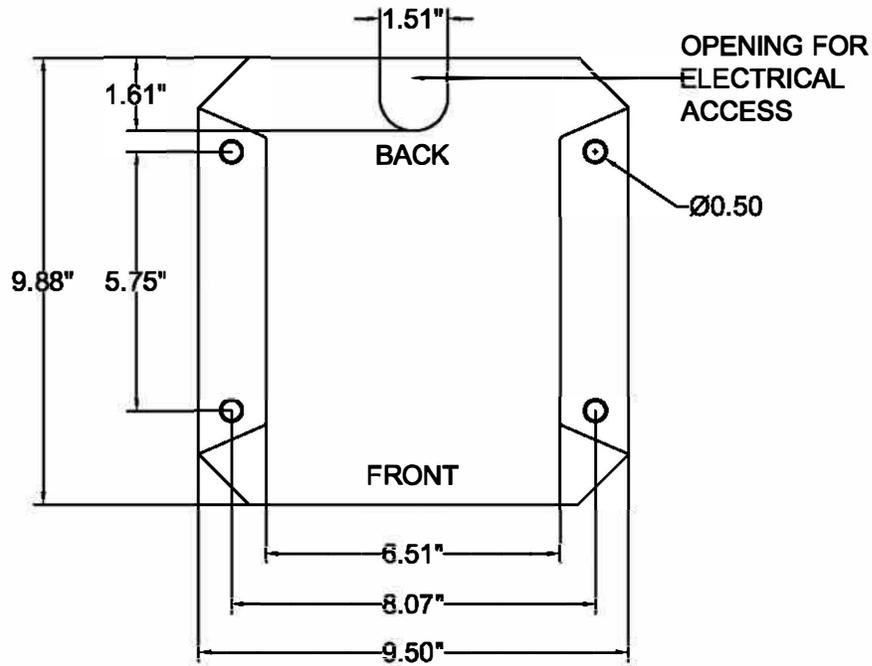

Wiring Diagram - Terminal Block

Wire Colors Per NEC

Line 1	L1	Black
Neutral	N	White
Ground	G	Green

